

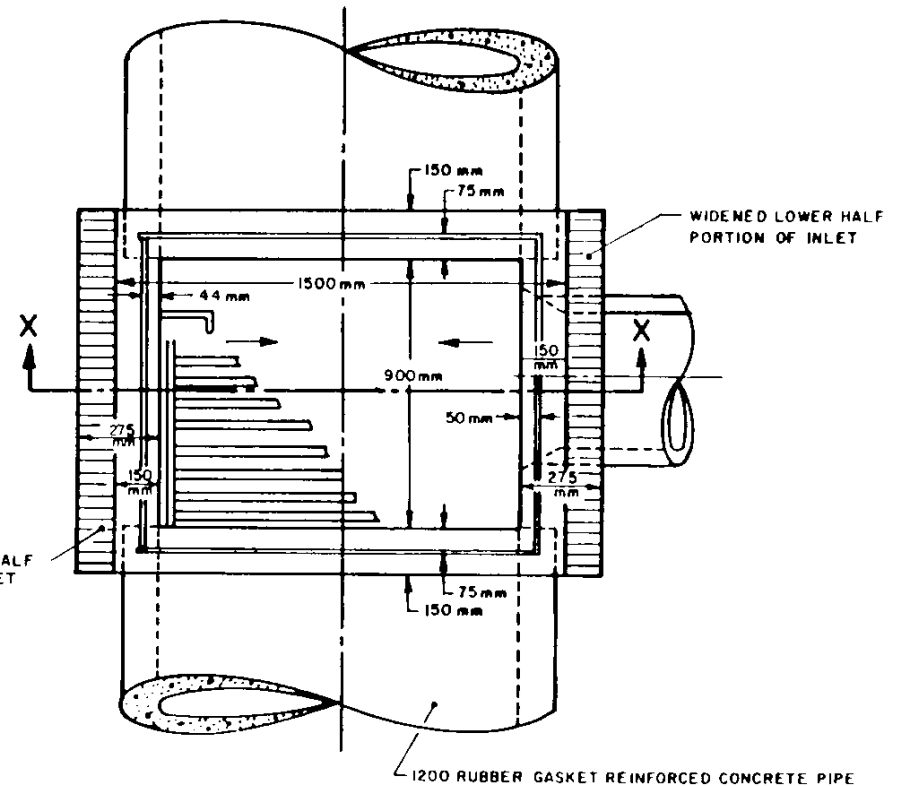


SECTION X-X

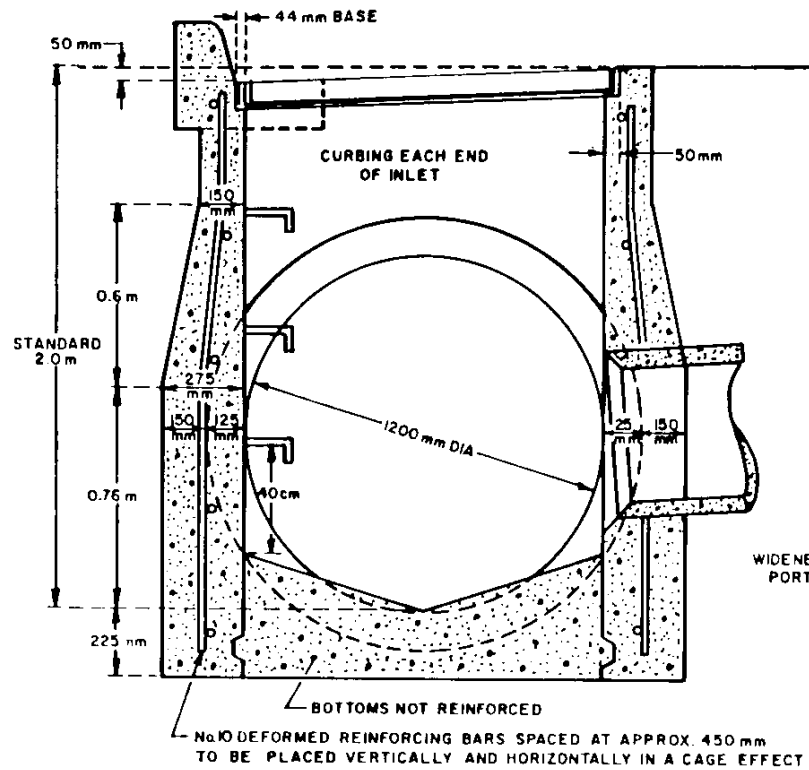

NOTE:

- STEEL LADDER RUNGS TO BE INSTALLED AT 40cm (± 5cm) INTERVALS TO HAVE ONE 19 mm STEEL RUNG 40cm FROM BOTTOM.
- DRAIN PIPES TO BE 1200mm RUBBER GASKET REINFORCED CONCRETE PIPE.
- TOP OF INLET TO BE FLUSH WITH TOP OF FINISHED PAVEMENT. PROVISION SHALL BE MADE IN CONSTRUCTION OF INLET TO ACCOMMODATE SURFACE DRAINAGE WHEN HIGHWAY CONSTRUCTION IS IN STAGES.
- STORM DRAIN GRATE AS PER PLAN 2.10.M7 OR 2.10.M11 TO BE USED.
- STANDARD STRUCTURE SHOWN NOMINAL METRIC DIMENSIONS

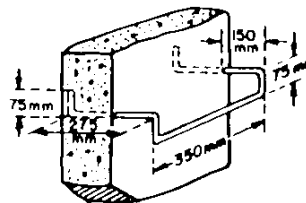

STEP DETAIL

Alberta
TRANSPORTATION
Engineering Division

DWG No	CB-6 2.10.M3
Date	
Original	May, 1979
Revised	Feb, 1985
Revised	

**STORM DRAIN INLET
1200 mm RUBBER GASKET
REINFORCED CONCRETE PIPE**