

= GENERAL NOTES =

DESIGN

Specifications Recommendations of the A.C.I.-A.S.C.E. Joint Committee and an allowable tension in the extreme top fiber of
 (a) 0.00% at time of transfer
 (b) 0.00% under final dead plus live load conditions
 Loading: A.A.S.D. H20-S16-44
 No allowance has been made for wearing surface.

MATERIALS

Prestressing steel is to conform to the requirements of A.S.T.M. specification A-270-56T (Tensile strength 250,000 p.s.i.)
 Mild steel reinforcing is to conform to the requirements of C.S.A. Specification G30.1 for intermediate grade reinforcing.
 Mild steel reinforcing is to be deformed in accordance with the requirements of C.S.A. Specification G30.1.
 The stringer concrete is to have a cylinder strength at 4000 p.s.i. before the prestressing force is transferred.
 Concrete to have a 28 day strength of 6000 p.s.i.
 Maximum size of aggregate to be 3/4".
 Stress-Strain Curves: A copy of the manufacturer's stress-strain curve for each lot of prestressing steel used and the location of each lot used shall be supplied to the Dept.

FABRICATION

All acute corners on skewed girders to have 3" chamfer.
 Concrete test cylinders shall be tested by an independent testing laboratory; copies of all test results shall be forwarded to the Bridge Branch.
 Tests shall be taken at the rate of one cylinder each two stringers with not less than two cylinders for each day's pouring.

Construction procedures are to comply with chapters 4 of the A.C.I.-A.S.C.E. Joint Committee Recommendations.
 Stringers are to be constructed under the direction of a qualified Engineer.
 Initial jacking forces shall be 27 3/4% strand for the top strands
 17.7 3/4% strand for the bottom strands.
 Exterior face of exterior stringers to be finished to a smooth, hard uniform color and texture, dense surface finish, other surfaces to have all pockets filled and all fins removed.
 Stringer Marks: Each stringer shall be marked with a number, 3" high and 1/2" deep, cast in the bottom of the stringer 6" from one end. Stressing data shall be supplied for each stringer and where applicable, the lot of prestressing steel shall be indicated on the stressing data sheet.




NOTE: LIFTING FORCE AT EACH BOLT IS TO BE VERTICAL AT ALL TIMES

FOR HOISTING DETAILS SEE DWG. 5760

**PRESTRESSED CONCRETE
 35 FT. SPAN
 TYPE 'K' STRINGER**







GOVERNMENT OF THE PROVINCE OF ALBERTA
 DEPARTMENT OF HIGHWAYS
 BRIDGE BRANCH, EDMONTON

FILE NO. _____ HWY. NO. _____ DWG. NO. **5755**
 LOCATION SCALE 1/2" = 1'-0" SHEET _____ OF _____
 STREAM SHEET _____ OF _____

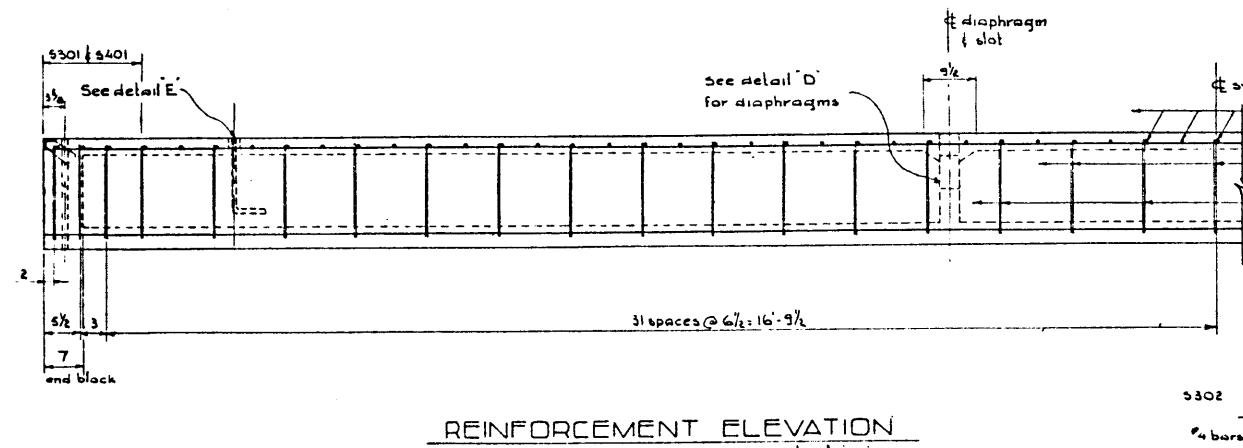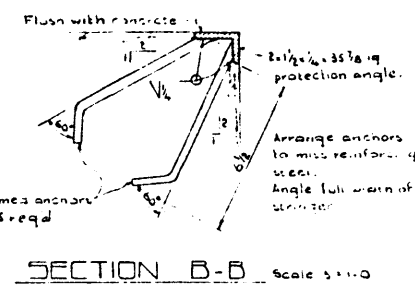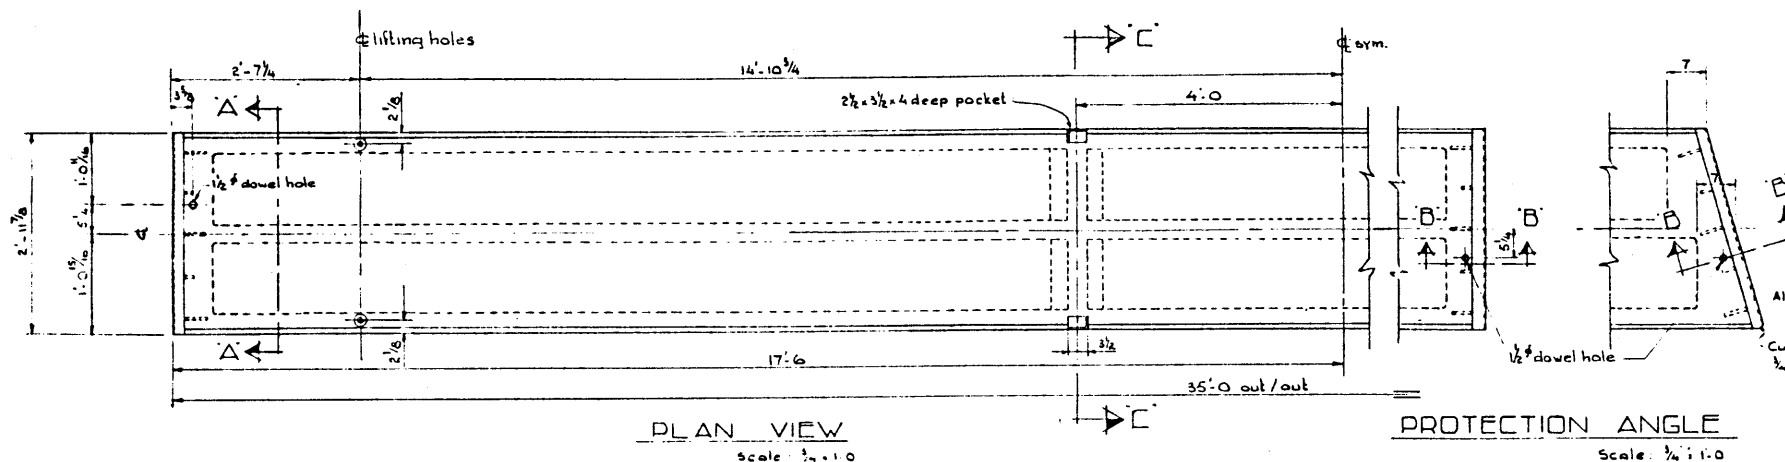

BAR LIST

Mark	Size	Number	Type	X	Length	Weight
S301	3	22	A		6-3	52
S302	3	30	B		2-1 1/2	24
S401	4	37	C		2-1	51
F401	4	67	Str		2-9	123
Total						250 lb

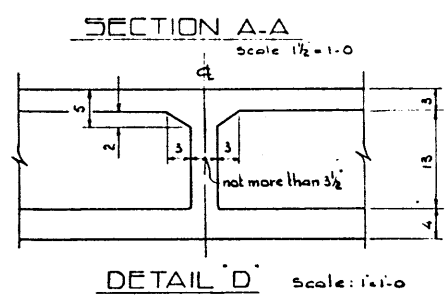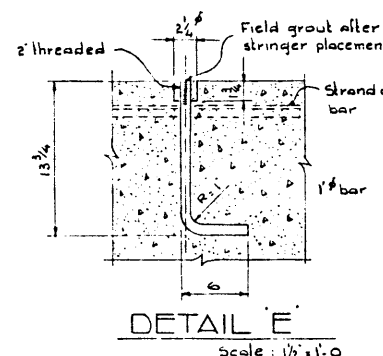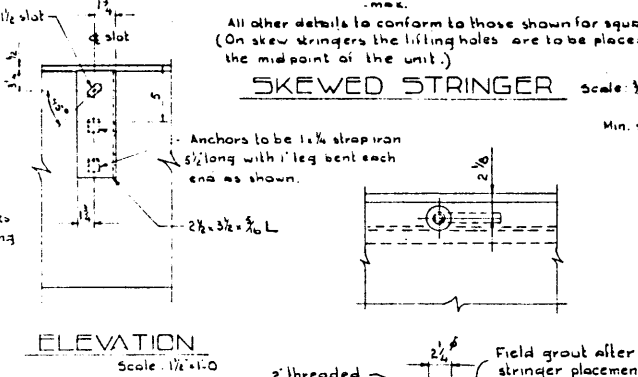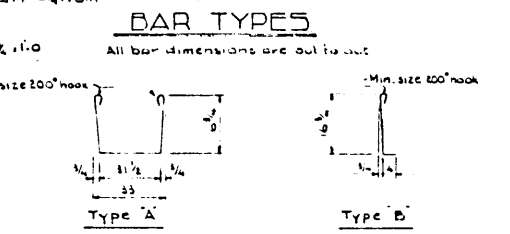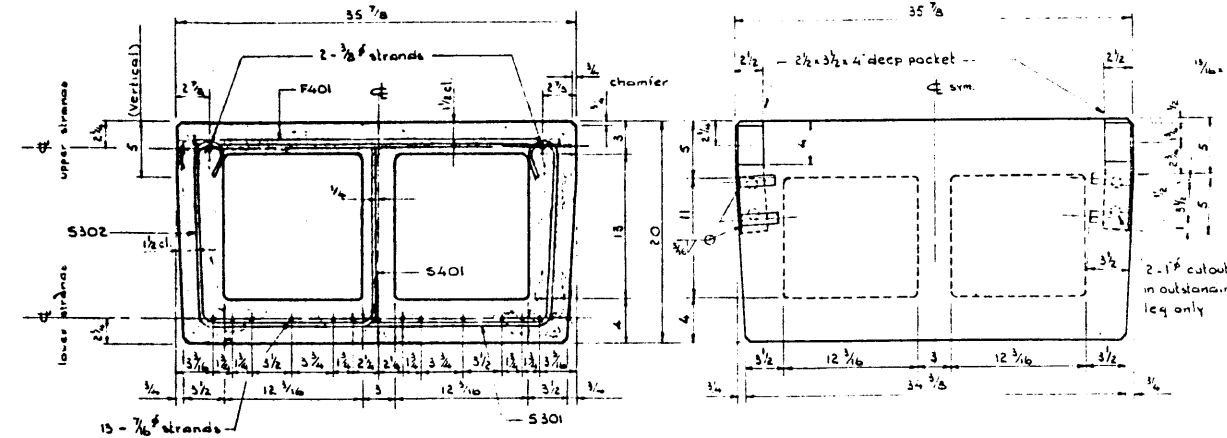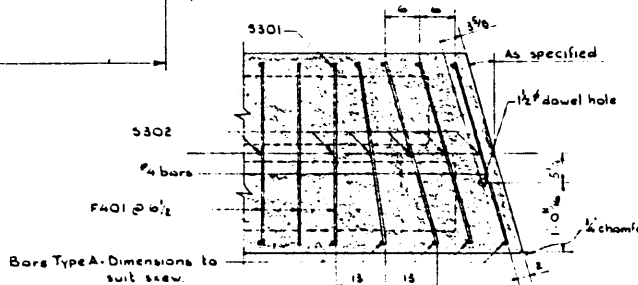

DESIGNED BY: P.P. ...
 DETAILED BY: R. E. ...
 CHECKED BY: ...
 DATE: April 18 51
 DATE: ...

Note: Skewed stringers to have skewed diaphragms

REVISIONS

NO.	DATE	DESCRIPTION	BY