
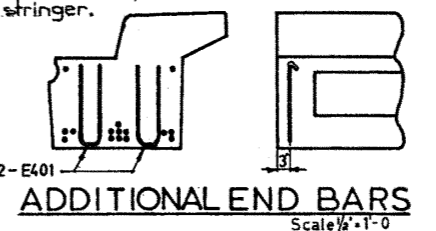

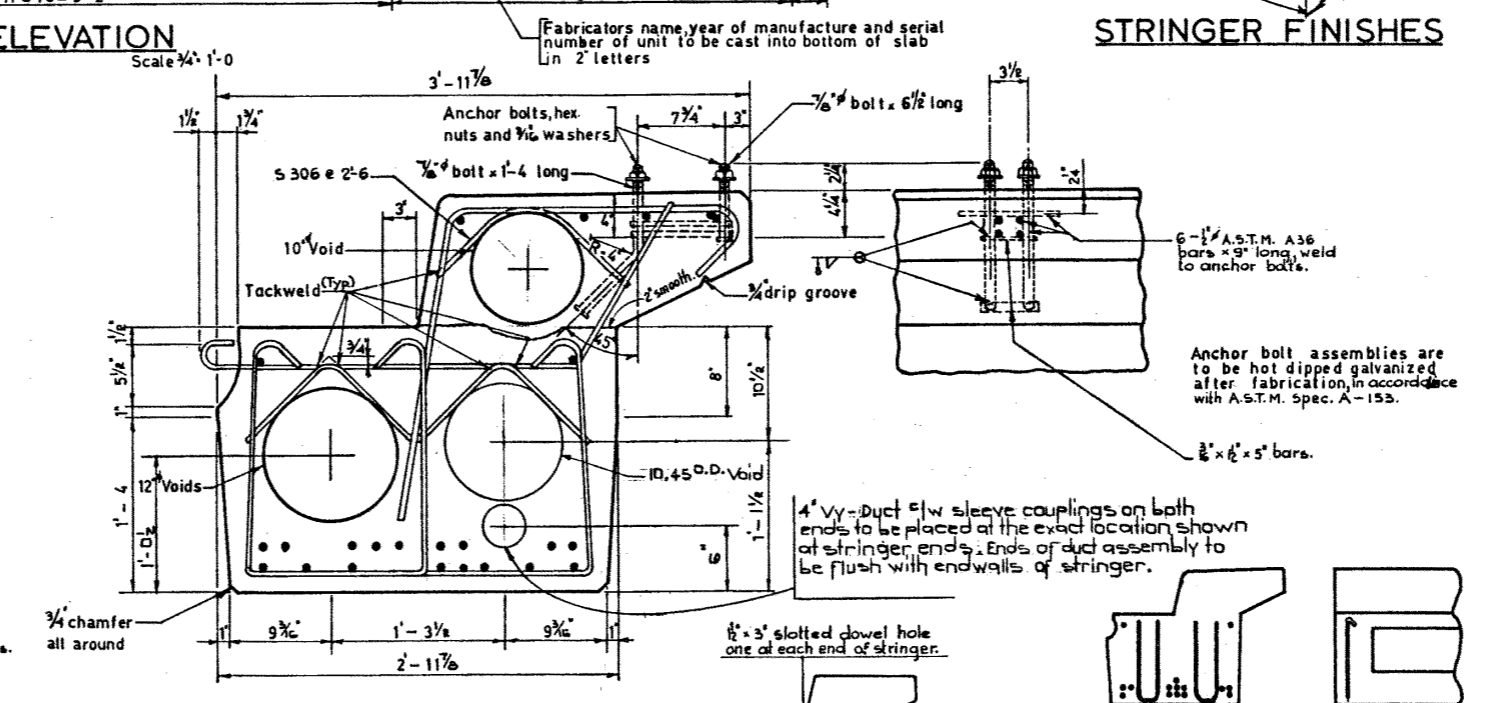
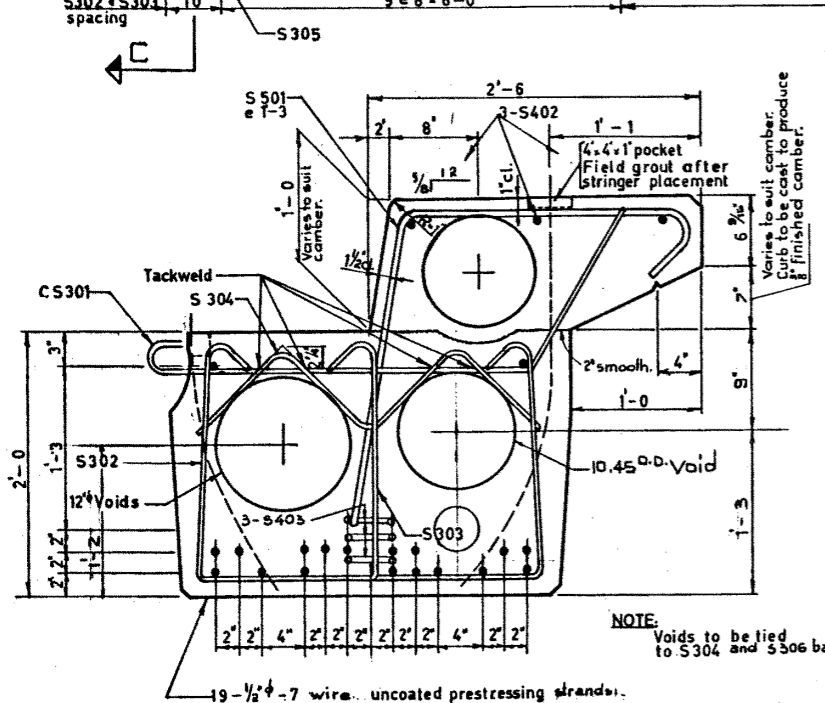
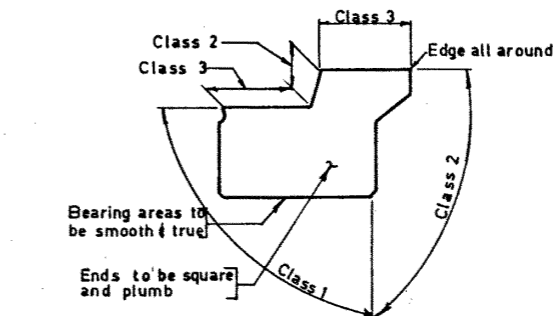
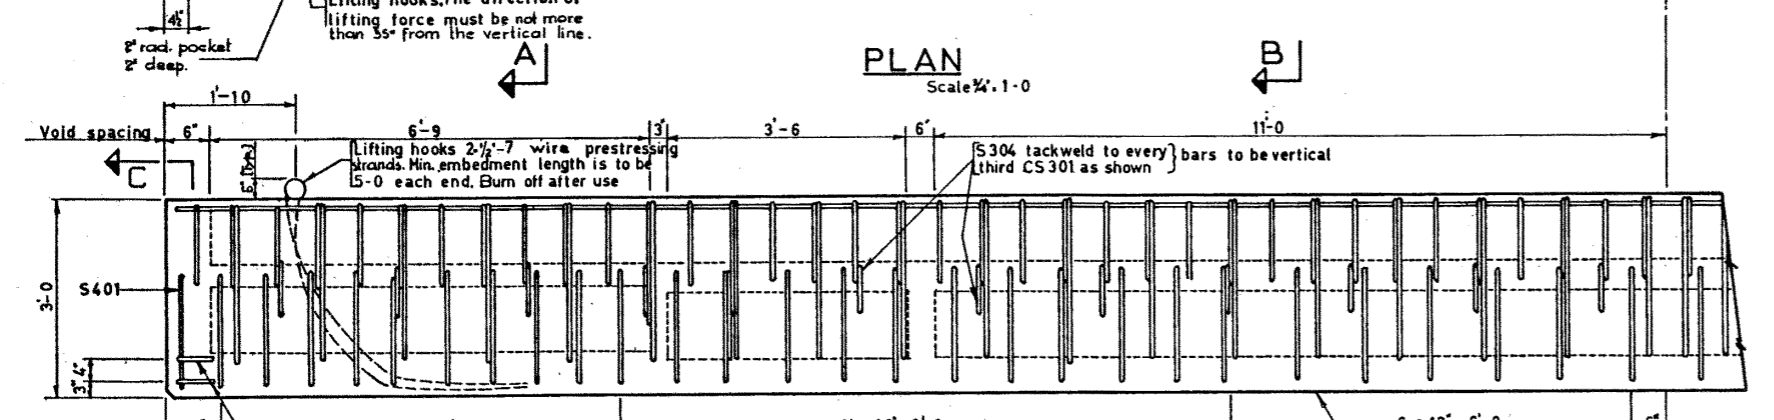
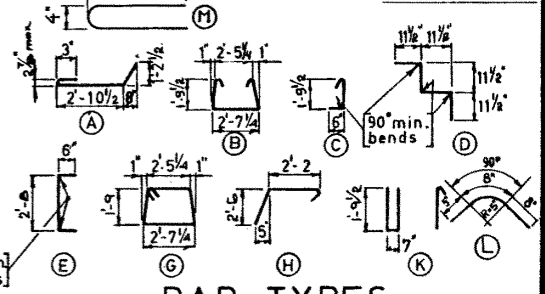
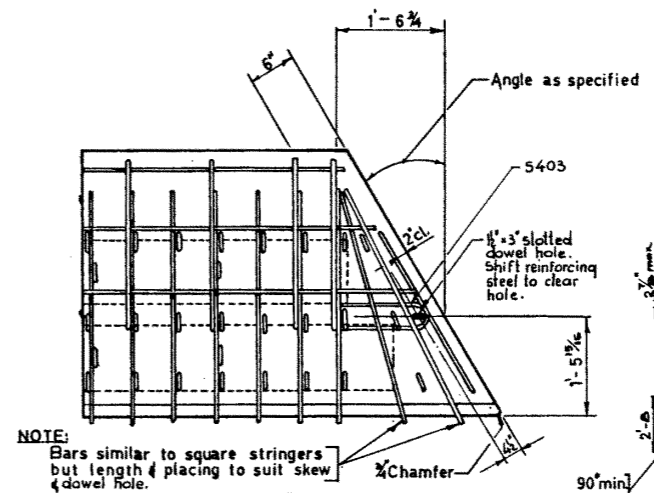


**BAR LIST**

Mark	Size	No	Type	Length	Weight
CS 301	3	72	A	4'-7"	124
S 302	3	54	B	6'-10"	139
S 303	3	54	C	2'-7"	52
S 304	3	24	D	3'-10"	35
S 305	3	4	E	3'-8"	6
S 401	4	2	G	9'-4"	12
S 402	4	6	Str	23'-0"	92
S 501	5	36	H	5'-2"	194
E 401	4	4	K	5'-2"	14
S 306	3	18	L	1'-9"	12
S 403	4	6	M	3'-0"	11

Total lbs 691

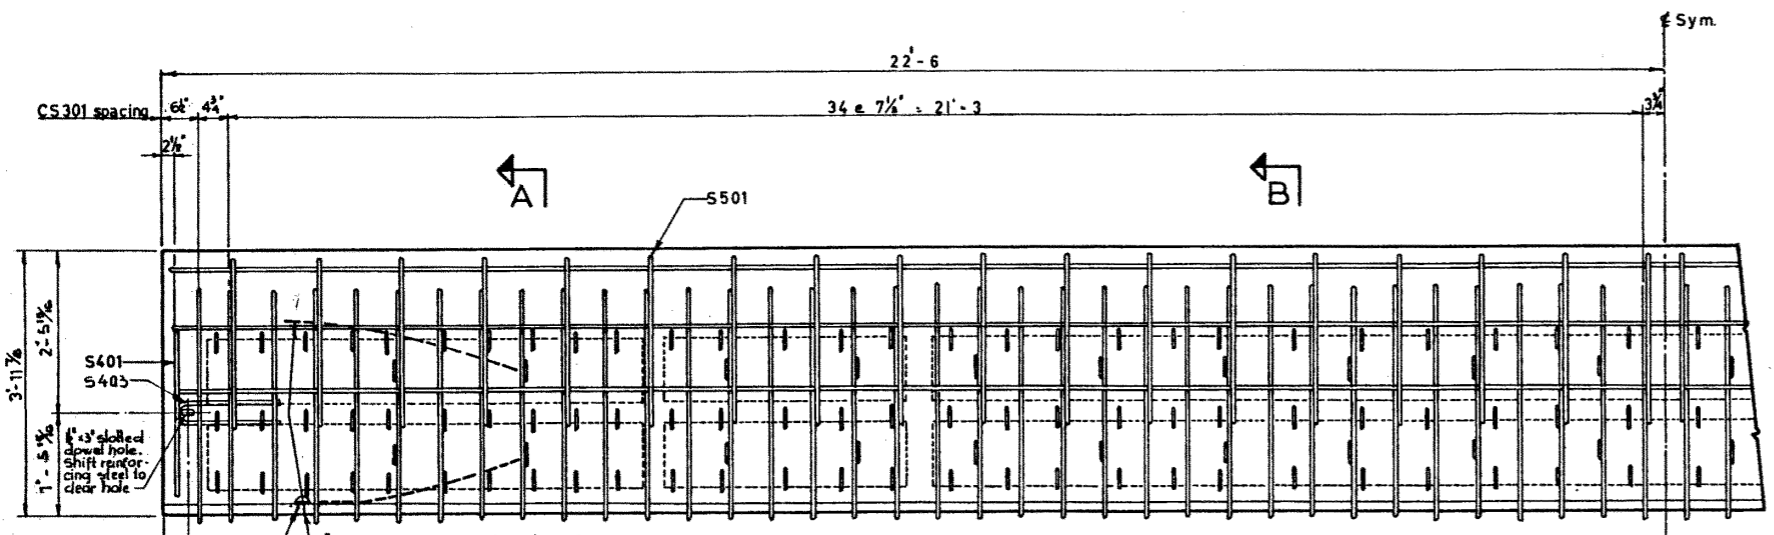

**GENERAL NOTES**

DESIGN  
A.A.S.H.O. 1961 Specifications except allowable initial concrete stress = 285 p.s.i. in tension.  
Loading: 3/5 of one wheel line of an H20-S16-44 truck plus full dead load plus 2" wearing surface.

MATERIALS  
Concrete shall be of standard weight aggregate with a maximum size of 3/4". Minimum compressive strength shall be 5000 p.s.i. at 28 days. Air entrainment shall be not less than 5%.

FABRICATION  
Reinforcement: Diameters of all bends and details of all hooks unless otherwise noted shall conform to the recommended sizes detailed in the A.C.I. Manual of Standard Practice for Detailing Reinforced Concrete Structures.  
Prestress Steel: Initial tensioning load = 25.2 k/strand  
Design load = 20.16 k/strand  
Concrete must attain 4,000 p.s.i. compressive strength before the prestressing force is transferred.  
Anchor bolt assemblies are to be cast in stringer at spacings as required.  
Units are to conform to the requirements of the Bridge Branch Specifications for Prestressed Concrete Bridge Units.  
The surface of grout keys shall be sandblasted. If end blockouts are called for their surfaces shall be sandblasted.

ERECTION  
Lifting force at each hook must be not more than 35° from the vertical line at all times. Stringer surface must be level at all times.

**SUPERSEDED**  
**DRAWING IN USE**  
**FROM A PHOTOGRAPH OF TRACING**

**PRESTRESSED CONCRETE**  
**45 FT. SPAN**  
**TYPE "M" CURB STRINGER**

GOVERNMENT OF THE PROVINCE OF ALBERTA  
DEPARTMENT OF HIGHWAYS  
BRIDGE BRANCH, EDMONTON

FILE NO. \_\_\_\_\_ HWY. NO. \_\_\_\_\_ DWG. NO. S-799-70  
LOCATION \_\_\_\_\_ SCALE as shown SHEET OF \_\_\_\_\_

NO.	DATE	DESCRIPTION	BY
		Redrawn	S.L.

REVISIONS

DESIGNED BY D.H. QUAPP DATE AUG 1962  
CHECKED BY L. KOHLMANN DATE AUG 1962